
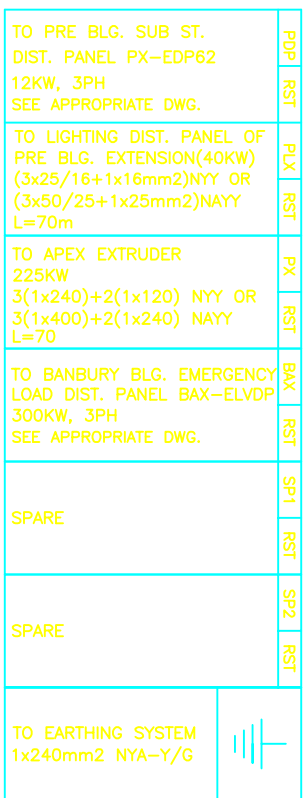
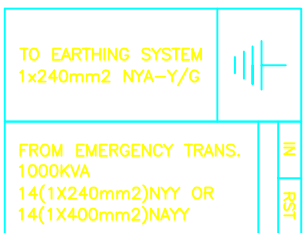



I S S U E S			
REV	DATE	COPY	ISSUED TO
	99.12.13	S.C.	KERMAN BAREZ TIRE CO.
9	1403.10.14	1	KERMAN BAREZ TIRE CO.

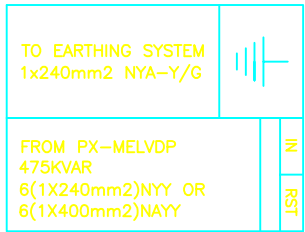


NOTES

- 1- DRY TYPE CAPACITOR SHOULD BE USED
- 2- CONTACTOR SHOULD BE SUITABLE FOR CAPACITOR
- 3- PANELS SPEC. ARE :
 - IP42
 - RAL 7035
 - INPUT & OUTPUT FROM BOTTOM
 - FREE STANDING PANEL
- 4- (*) LOADS SHOULD BE FINALIZED BY CLIENT
- 5- (M) STAND FOR MOTOR OPERATED
- 6- MULTI FUNCTION METER(MF) MUST HAS ONE OF RS232 OR RS485 PORT

FOR CONSTRUCTION

[illegible]

		KERMAN BAREZ TIRE CO. RADIAL TIRE MANUFACTURING PLANT-KERMAN(EXTENSION)	
Industries Group CONSULTING ENGINEERS		TIRE PRE FABRICATING	
SCALE		PROJECT NUMBER	9662
DRAWN	M.A.	DRAWING NUMBER	1.62.3309
CHECKED	M.A.	REV.	0
APPROVED	S.J.		
DATE	99.12.13		
ADD FILE	62623309	CLIENT'S DRAWING NUMBER	