


LEGEND:



I S S U E S			
REV	DATE	COPY	ISSUED TO
99.12.13	S.C.		KERNAN BAREZ TIRE CO.
d	1/00.10.14	1	KERNAN BAREZ TIRE CO.

NOTES & ABB.S:

- 1- ALL METAL PARTS (STRUCTURE, CABLE TRAYS, BODY OF PANELS & TRANSFORMERS) MUST BE CONNECTED TO EARTH BUS BY 1x120 mm2 NYA,Y/G CABLE.
- 2- FOR NOTES, LEGENDS, STANDARD DETAILS & TYPICAL CABLE LADDER INSTALLATION SEE DRAWINGS No.S 4.993301&16
- 3- CONTRACTOR SHOULD COORDINATE ANY INTERSECTION BETWEEN ELECTRICAL AND OTHER EQUIPMENTS OR OBSTACLES AND KEEP ENOUGH SPACE BETWEEN THEM.

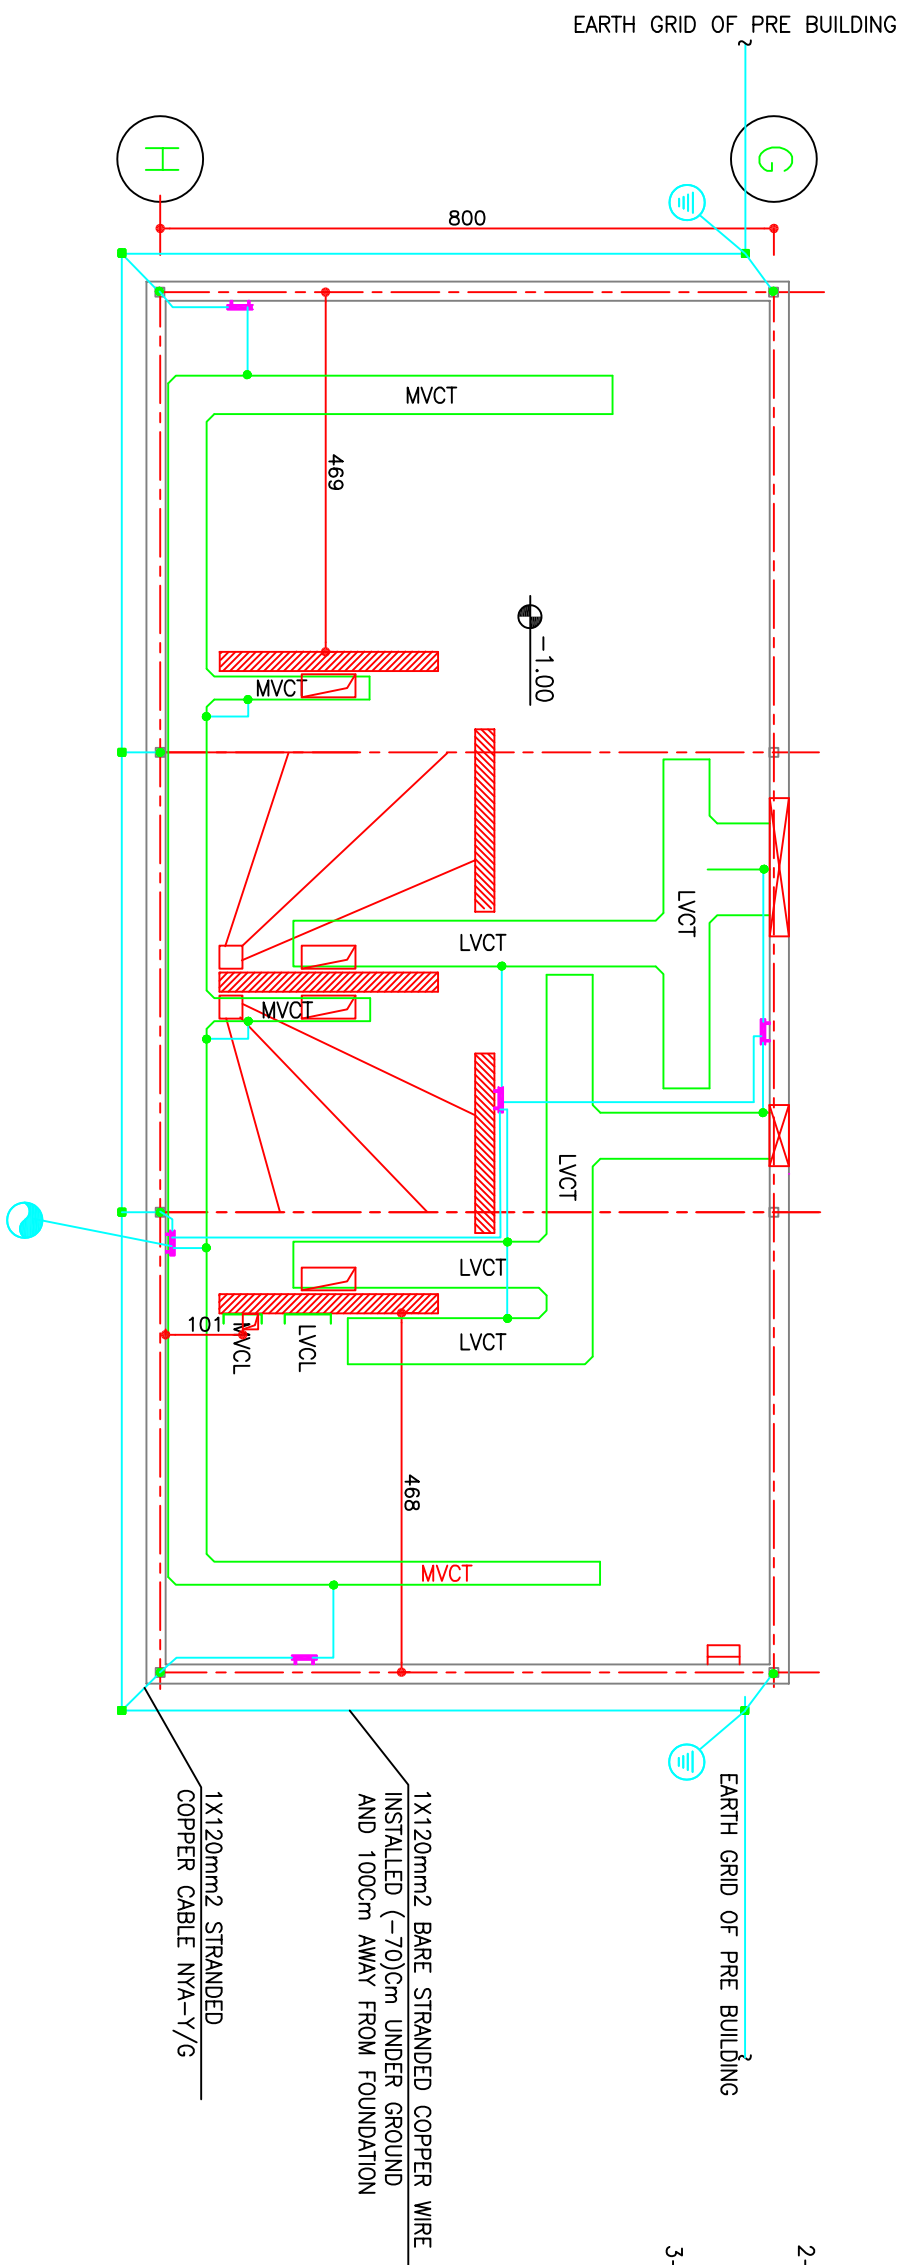

FOR CONSTRUCTION

[illegible]